
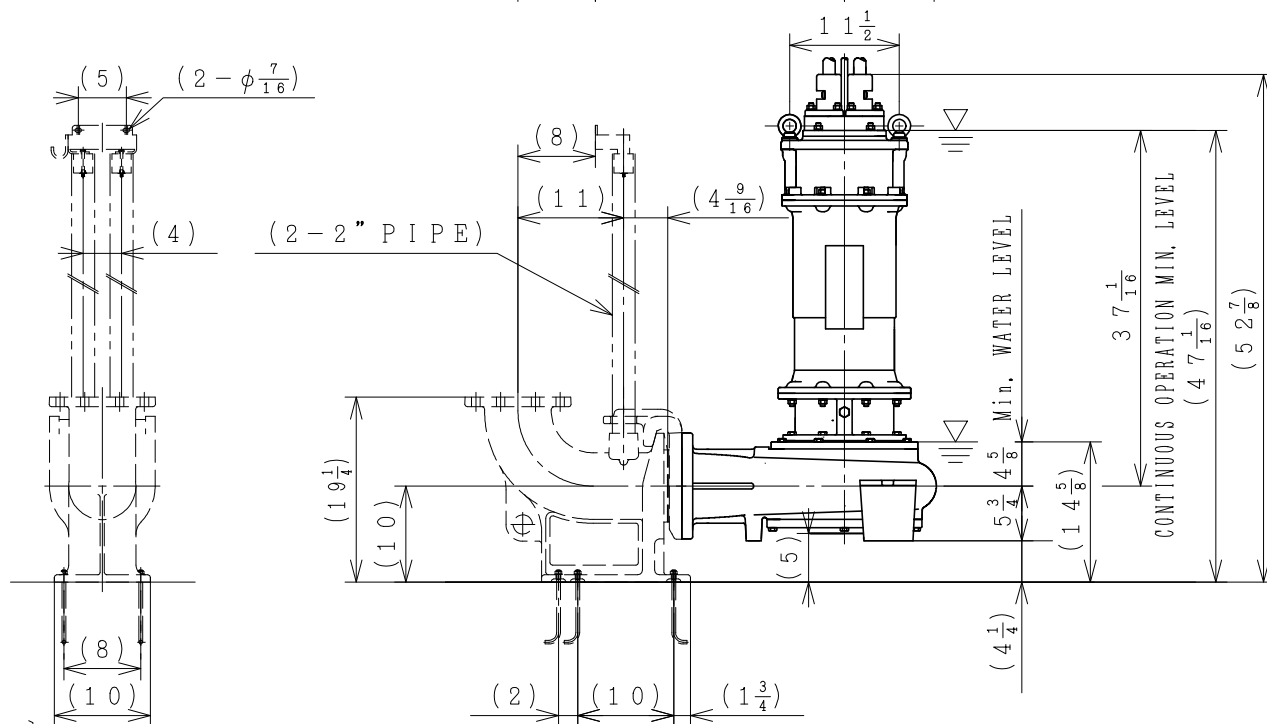
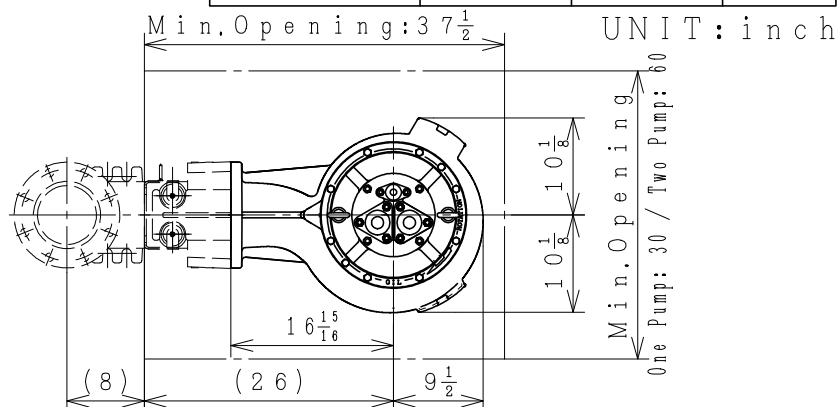


GUIDE RAIL INSTALLATION TYPE

FLANGE (ANSI 150 PSI F.F)

e	f	t	n	h
$9\frac{1}{2}$	11	1	8	$\frac{7}{8}$

MODEL	Impeller No.	RATED POWER (HP)	FREQ.
6CNX415T2E 6CNX415T3E	150-2H(S)	20	60
6CNX418T2E 6CNX418T3E	185-2HD(S)	25	60
6CNX422T2E 6CNX422T3E	220-2HD(S)	30	60

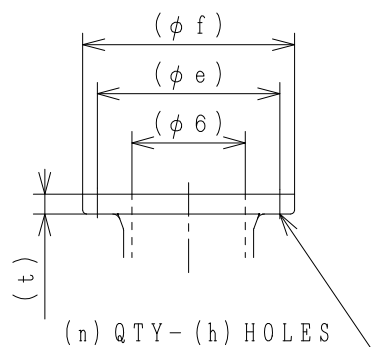

[Note]

In the event of continuous operation, the CONTINUOUS OPERATION MIN. LEVEL must be maintained.

Limit operation to 15 minutes (maximum) when operating the pump between the MIN. LEVEL and CONTINUOUS OPERATION MIN. LEVEL.

Cables are not shown on this drawing.

Recommend Guide Rail is CONERY MFG INC Type BERS-0600.



DWG.	M. Higuchi	May 22, 2013
JUDG.	K. Takeuchi	May 23, 2013
APPD.	M. Ikeda	May 23, 2013

TITLE

PUMP DIMENSION

DWG No.

A405275