



GUIDE RAIL INSTALLATION TYPE

FLANGE (ANSI 150 PSI F.F)

e	f	t	n	h
$7\frac{1}{2}$	9	1	8	$\frac{3}{4}$

M O D E L	Impeller No.	RATED POWER (H P)	FREQ.
4CNXH418T2E 4CNXH418T3E	185-2HD (S)	2 5	6 0
4CNXH422T2E 4CNXH422T3E	220-2HD (S)	3 0	6 0

UNIT : i n c h

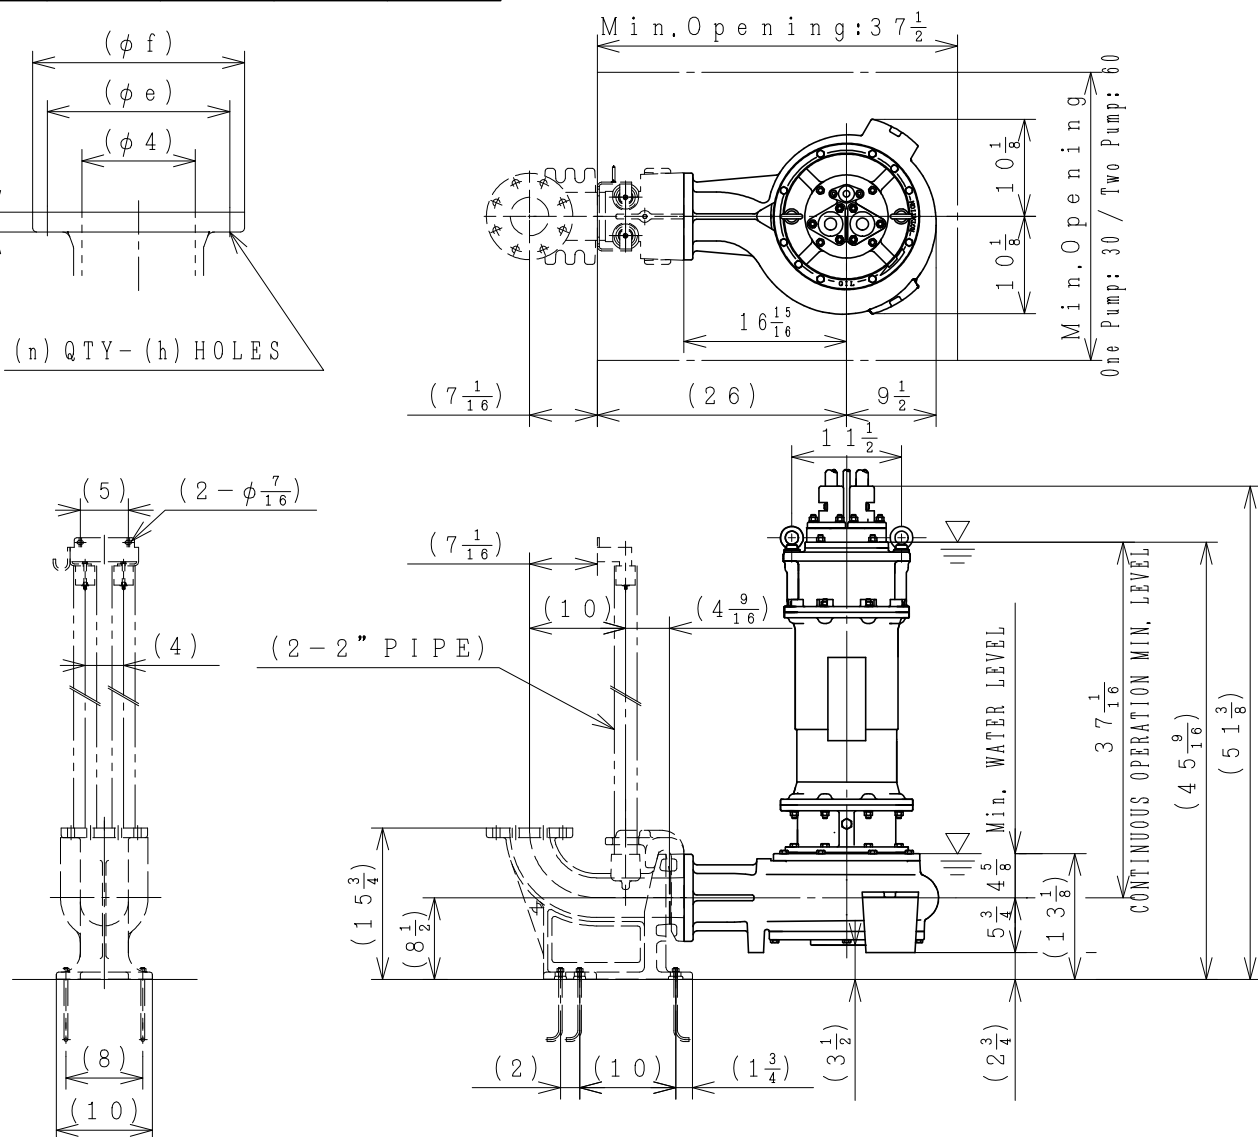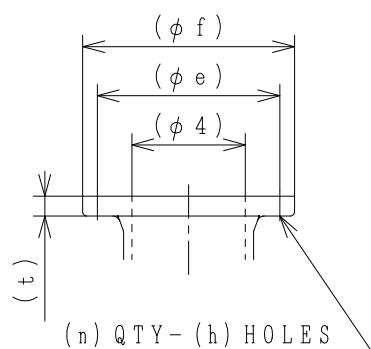

[N o t e]

In the event of continuous operation, the CONTINUOUS OPERATION MIN. LEVEL must be maintained.

Limit operation to 15 minutes (maximum) when operating the pump between the MIN. LEVEL and CONTINUOUS OPERATION MIN. LEVEL.

Cables are not shown on this drawing.

Recomend Guide Rail is CONERY MFG INC Type BERS-0400.



DWG.	M. Higuchi	Jul. 29, 2013
------	------------	---------------

JUDG.	K. Takeuchi	Jul. 31, 2013
-------	-------------	---------------

APPD.	M. Ikeda	Aug. 1, 2013
-------	----------	--------------

T I T L E

P U M P D I M E N S I O N

DWG No.

A 4 0 5 6 0 5