
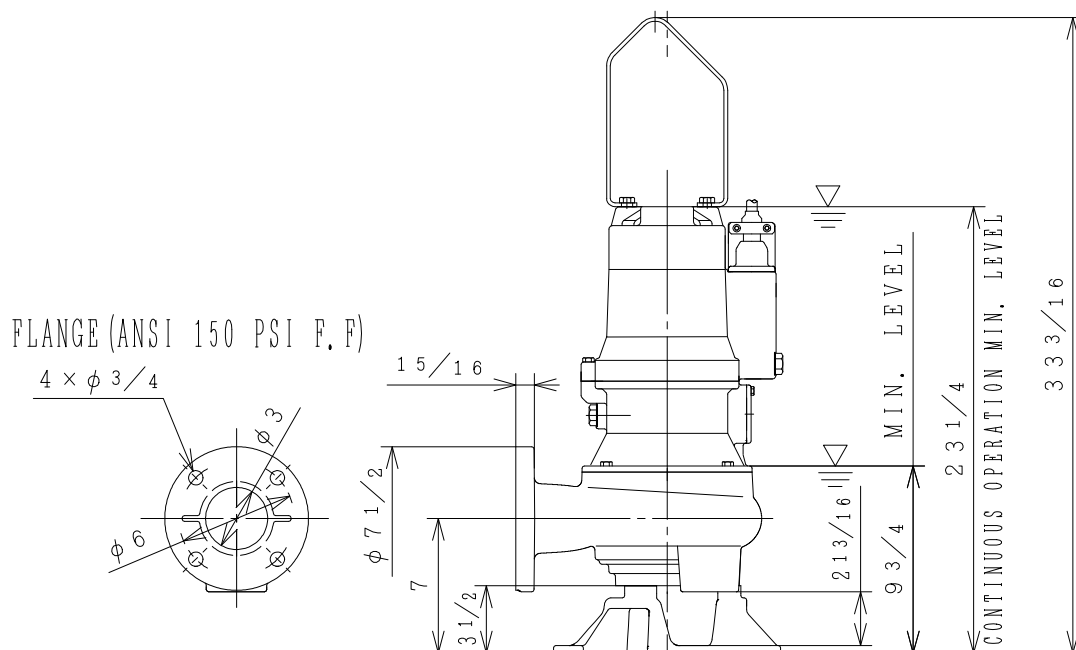


STAND ALONE INSTALLATION TYPE

M O D E L	I m p e l l e r N o.	R A T E D P O W E R (H P)	F R E Q.
3CNWX41.5T2E	15-2 (S)	2	60
3CNWX41.5T3E			

UNIT : i n c h

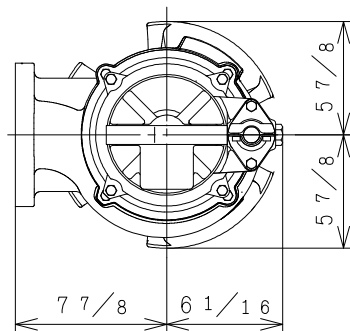

[Note] Limit operation to 30 minutes (maximum) when operating the pump between the MIN. LEVEL and CONTINUOUS OPERATION MIN. LEVEL. In the event of continuous operation, the CONTINUOUS OPERATION MIN. LEVEL must be maintained.
Cables are not shown on this drawing.



DWG.	N. Tanaka	Aug. 04, 2014
JUDG.	K. Takeuchi	Aug. 22, 2014
APPD.	M. Tarui	Aug. 25, 2014

T I T L E

P U M P D I M E N S I O N

DWG No.
A 4 0 8 2 8 6