




STAND ALONE INSTALLATION TYPE

M O D E L	Impeller No.	RATED POWER (H P)	F R E Q.
4CNWX47.5T2E	75-2 (S)	10	60
4CNWX47.5T3E			

UNIT : i n c h

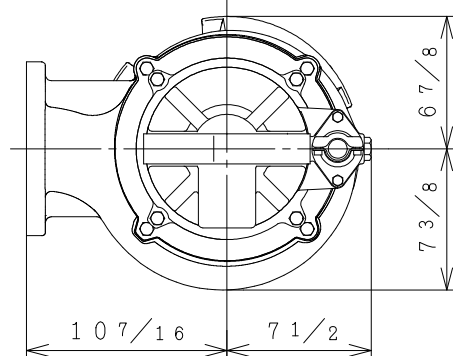

FLANGE (ANSI 150 PSI F.F)

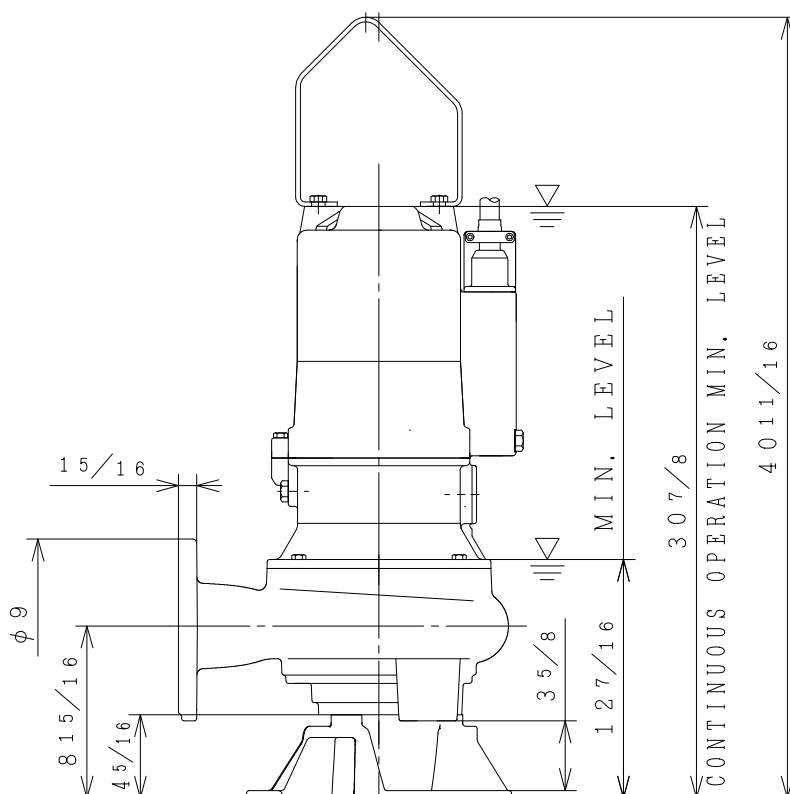

[Note] Limit operation to 30 minutes (maximum) when operating the pump between the MIN. LEVEL and CONTINUOUS OPERATION MIN. LEVEL. In the event of continuous operation, the CONTINUOUS OPERATION MIN. LEVEL must be maintained.
Cables are not shown on this drawing.



DWG. N Tanaka Aug. 04, 2014

JUDG.	K. Takeuchi	Aug. 22, 2014
-------	-------------	---------------

APPD.	M. Tarui	Aug. 25, 2014
-------	----------	---------------

T I T L E

P U M P D I M E N S I O N

DWG No.

A 4 0 8 2 9 5