




GUIDE RAIL INSTALLATION TYPE

FLANGE (ANSI 150 PSI F.F)

e	f	t	n	h
$7\frac{1}{2}$	9	1	8	$\frac{3}{4}$

MODEL	Impeller No.	RATED POWER (HP)	FREQ.
4CNXH411T2E1	110-2H (S)	15	60
4CNXH411T3E1			

UNIT: inch

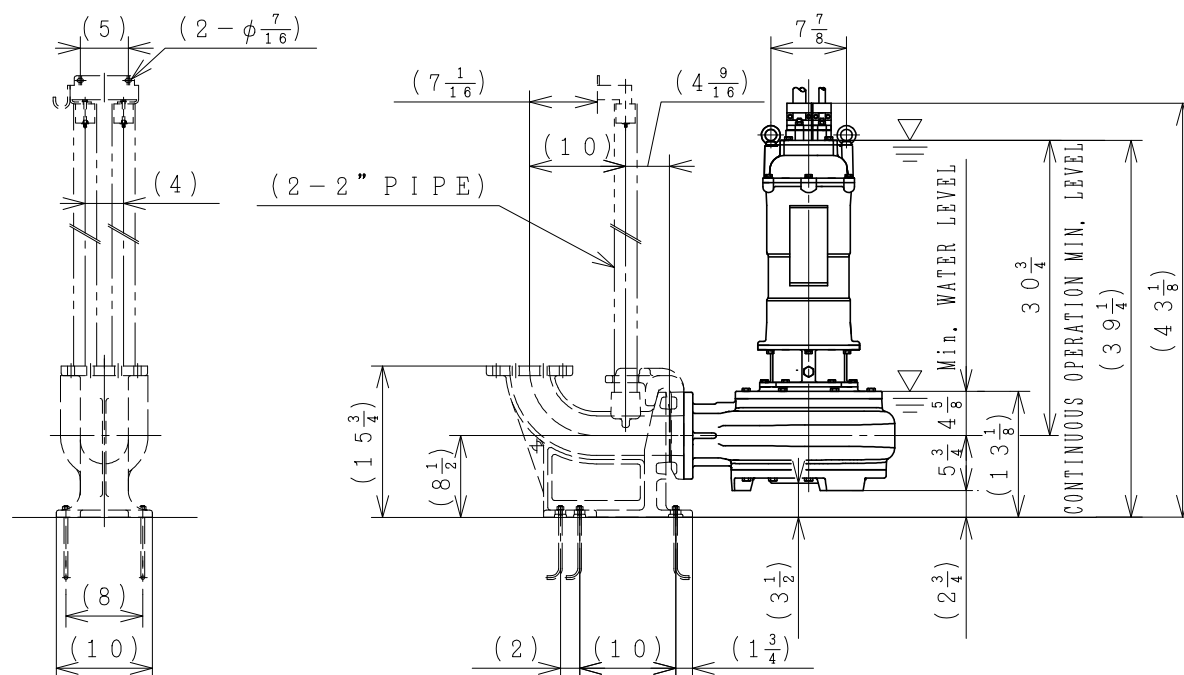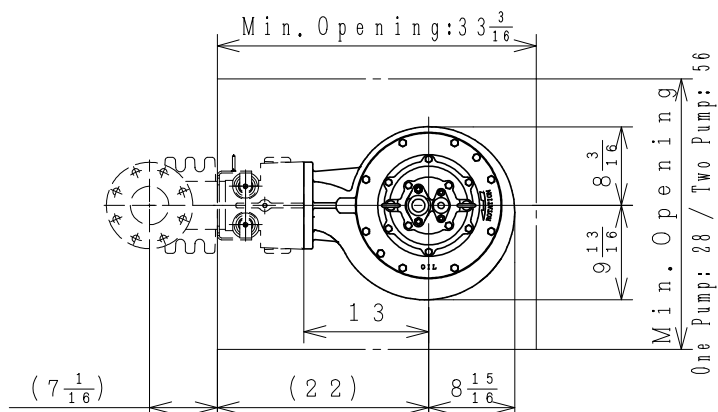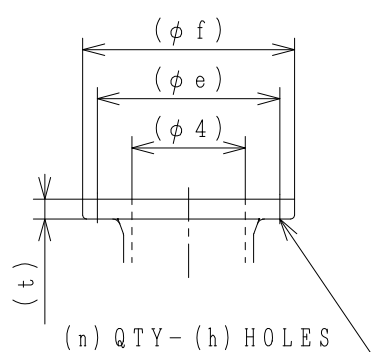

[Note]

In the event of continuous operation, the CONTINUOUS OPERATION MIN. LEVEL must be maintained.

Limit operation to 15 minutes (maximum) when operating the pump between the MIN. LEVEL and CONTINUOUS OPERATION MIN. LEVEL.

Cables are not shown on this drawing.

Recommend Guide Rail is CONERY MFG INC Type BERS-0400.



DWG.	M. Higuchi	Mar. 8, 2018
JUDG.	M. Tarui	Mar. 8, 2018
APPD.	M. Tarui	Mar. 8, 2018

TITLE

PUMP DIMENSION

DWG No.

A418482